

Report No.:

Test Time: 2025-12-24 09:50

## Luminaire Property

Luminaire Manufacturer:

Luminaire Category:

Lamp Catalog: 3000K

Number of Lamps:

Luminous Length (mm): 250

Luminous Height (mm):

Current: 0.0500 A

Power Factor: 0.8900

Luminaire Description: L250

Lamp Description:

Lumens per Lamp:

Luminous Width (mm): 250

Voltage: 231.40 V

Power: 10.31 W

## Photometric Results

CIE Class: Direct

Measurement Flux: 1107.5 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H113.9

Vertical Diffuse Angle(50%): V114

Luminous Efficacy (lm/w): 107.42

Max. Intensity: 343.19 cd/klm

S/MH(C0/C180): 1.26

Total Rated Lamp Lumens: 1107.5 lm

Efficiency: 100%


Upward Ratio: 0%

C0r0 Intensity: 341.63 cd/klm


Pos of Max. Intensity: H90 V0

S/MH(C90/C270): 1.26

Picture Of Luminaire



Luminous Intensity Distribution Curve

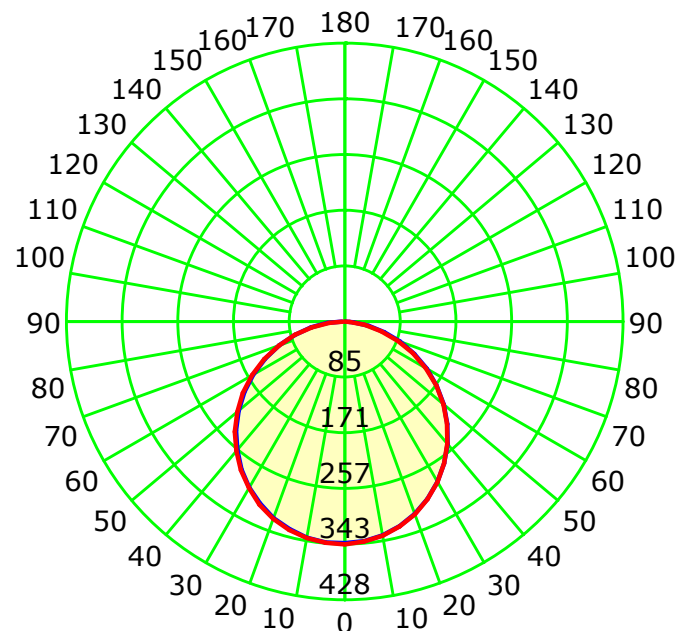

Unit: cd/klm

Average Diffuse Angle(50%): 113.9°

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0


Test Device: GPM-1600L

Distance: 7.172 m [K=1.0000]

Humidity:

Inspector:


## Luminous Intensity Distribution Curve

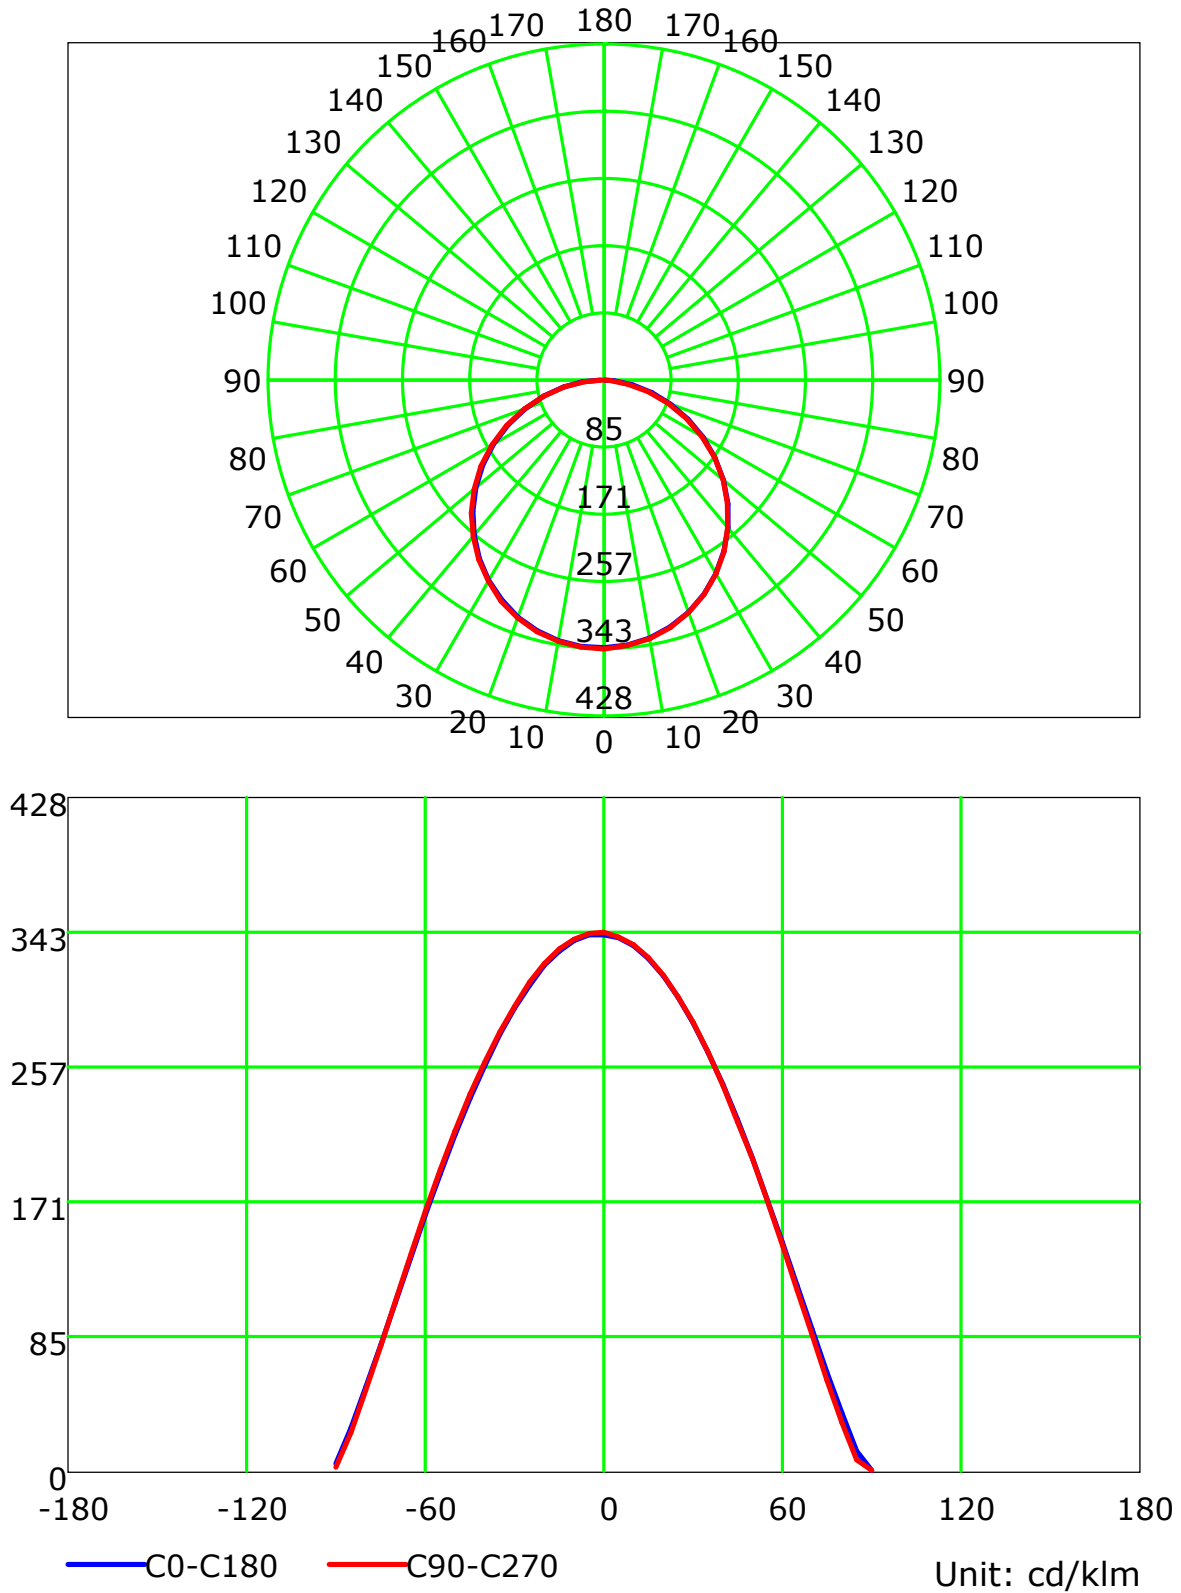

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Luminous Intensity Distribution Curve(cd/klm)

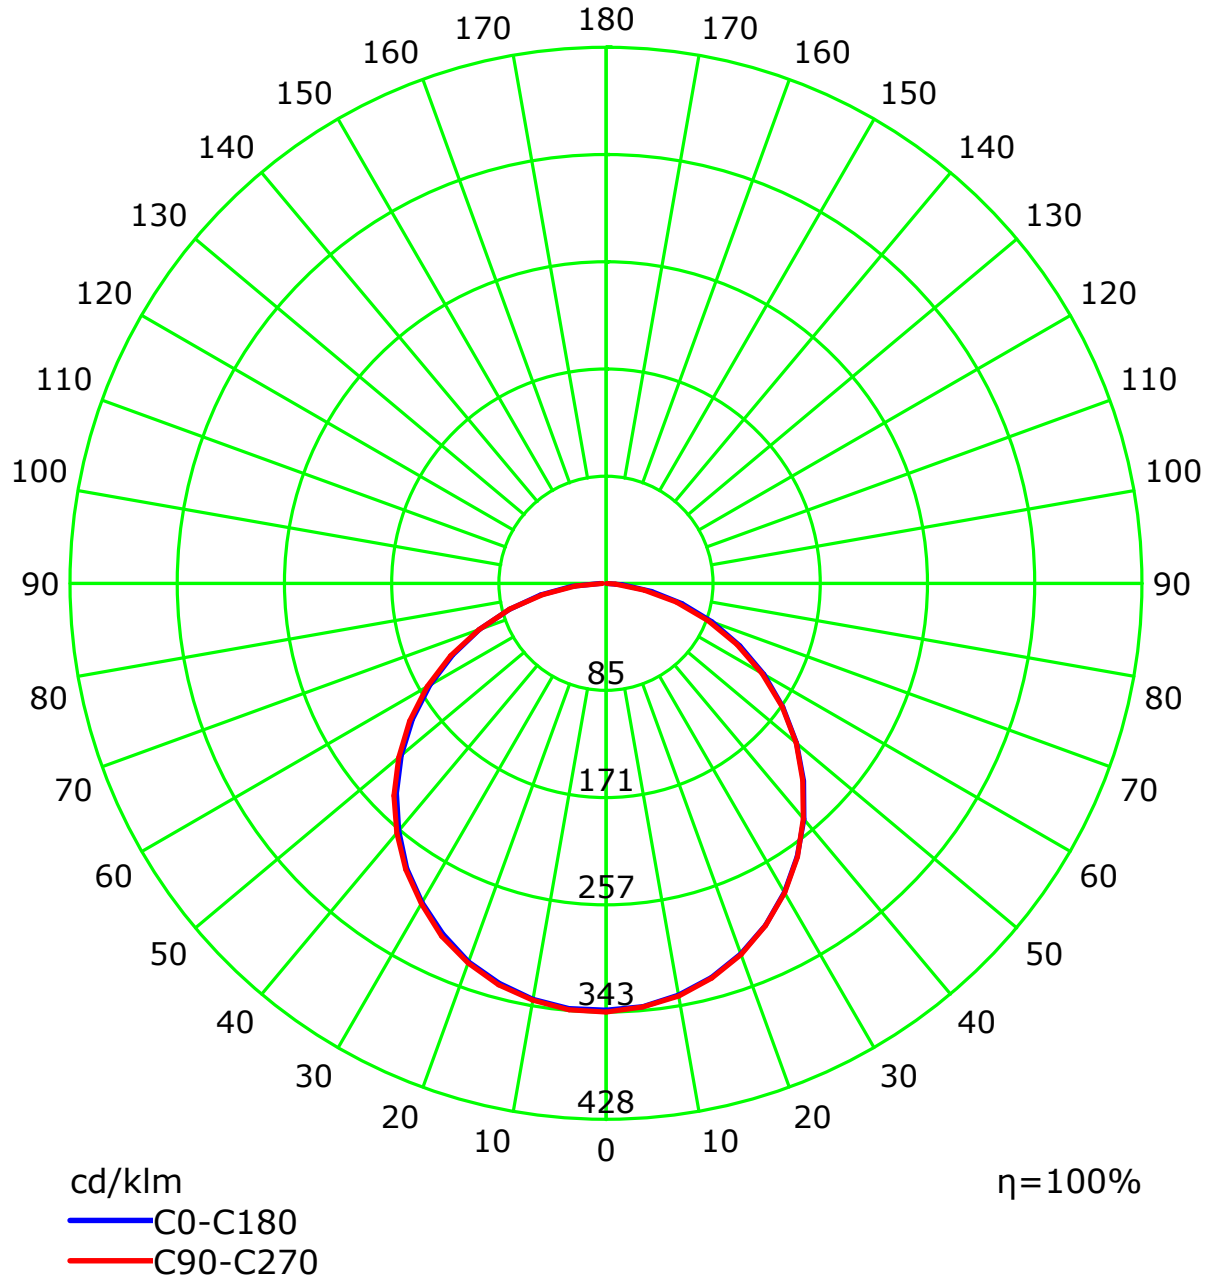


C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	1.19	1.19	1.19	1.19	1.16	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1	1.08	1.04	0.99	0.95	1.06	1.01	0.97	0.94	0.97	0.94	0.91	0.93	0.90	0.88	0.89	0.87	0.85	0.83
2	0.98	0.90	0.83	0.77	0.96	0.88	0.82	0.76	0.84	0.79	0.74	0.81	0.77	0.73	0.78	0.74	0.71	0.69
3	0.90	0.79	0.70	0.64	0.87	0.77	0.70	0.63	0.74	0.68	0.62	0.71	0.66	0.61	0.69	0.64	0.60	0.58
4	0.82	0.70	0.61	0.54	0.80	0.68	0.60	0.54	0.66	0.59	0.53	0.63	0.57	0.52	0.61	0.56	0.51	0.49
5	0.75	0.62	0.53	0.46	0.73	0.61	0.53	0.46	0.59	0.51	0.46	0.57	0.50	0.45	0.55	0.49	0.45	0.42
6	0.69	0.56	0.47	0.40	0.68	0.55	0.46	0.40	0.53	0.46	0.40	0.51	0.45	0.39	0.50	0.44	0.39	0.37
7	0.64	0.51	0.42	0.36	0.63	0.50	0.41	0.35	0.48	0.41	0.35	0.47	0.40	0.35	0.46	0.39	0.35	0.33
8	0.60	0.46	0.38	0.32	0.58	0.46	0.37	0.32	0.44	0.37	0.31	0.43	0.36	0.31	0.42	0.36	0.31	0.29
9	0.56	0.42	0.34	0.29	0.55	0.42	0.34	0.28	0.41	0.33	0.28	0.40	0.33	0.28	0.39	0.32	0.28	0.26
10	0.52	0.39	0.31	0.26	0.51	0.39	0.31	0.26	0.38	0.31	0.26	0.37	0.30	0.26	0.36	0.30	0.25	0.24


Spacing Criteria (0-180): 1.26  
Spacing Criteria (90-270): 1.26  
Spacing Criteria (Diagonal): 1.38

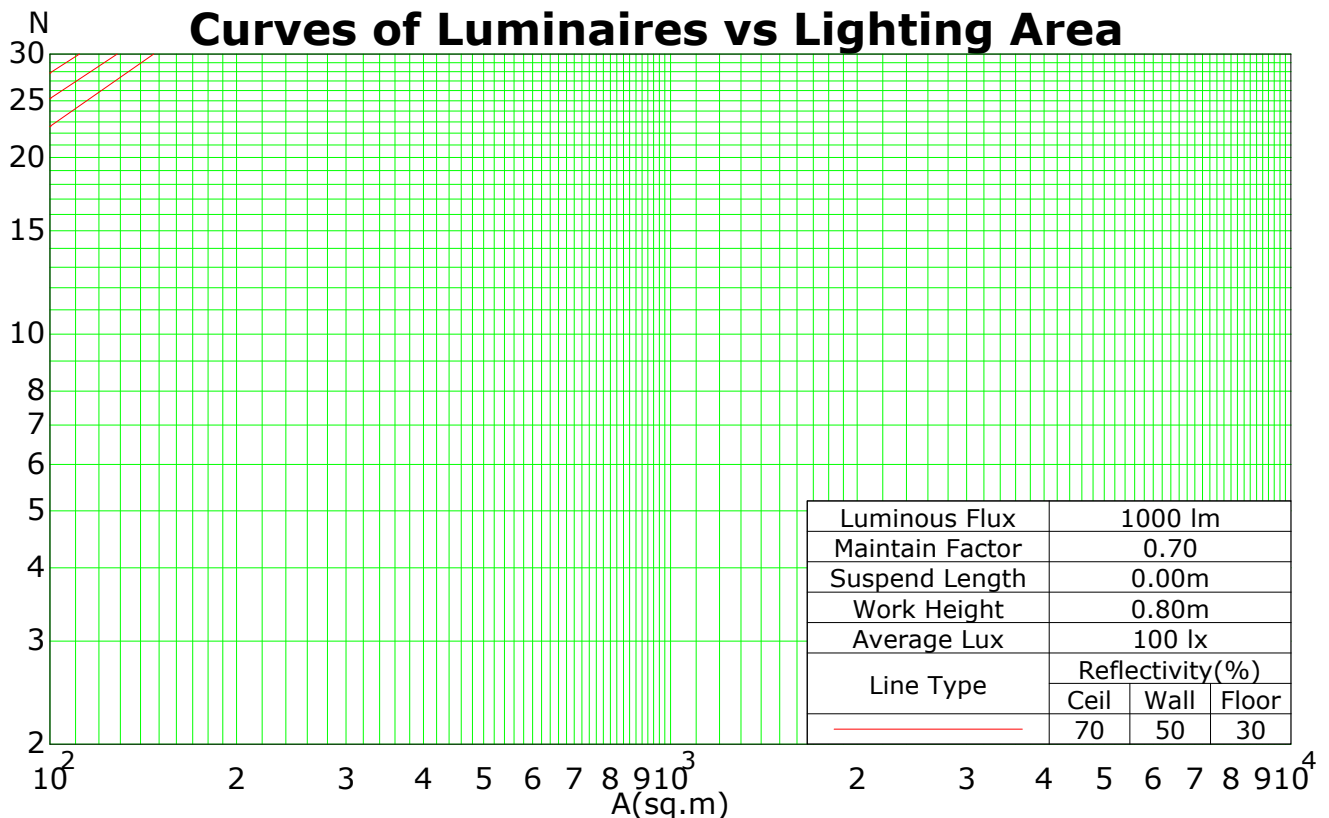

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:5.0  
Test Device: GPM-1600L  
Distance: 7.172 m [K=1.0000]  
Humidity:  
Inspector:


## Isocandela (rectangle)

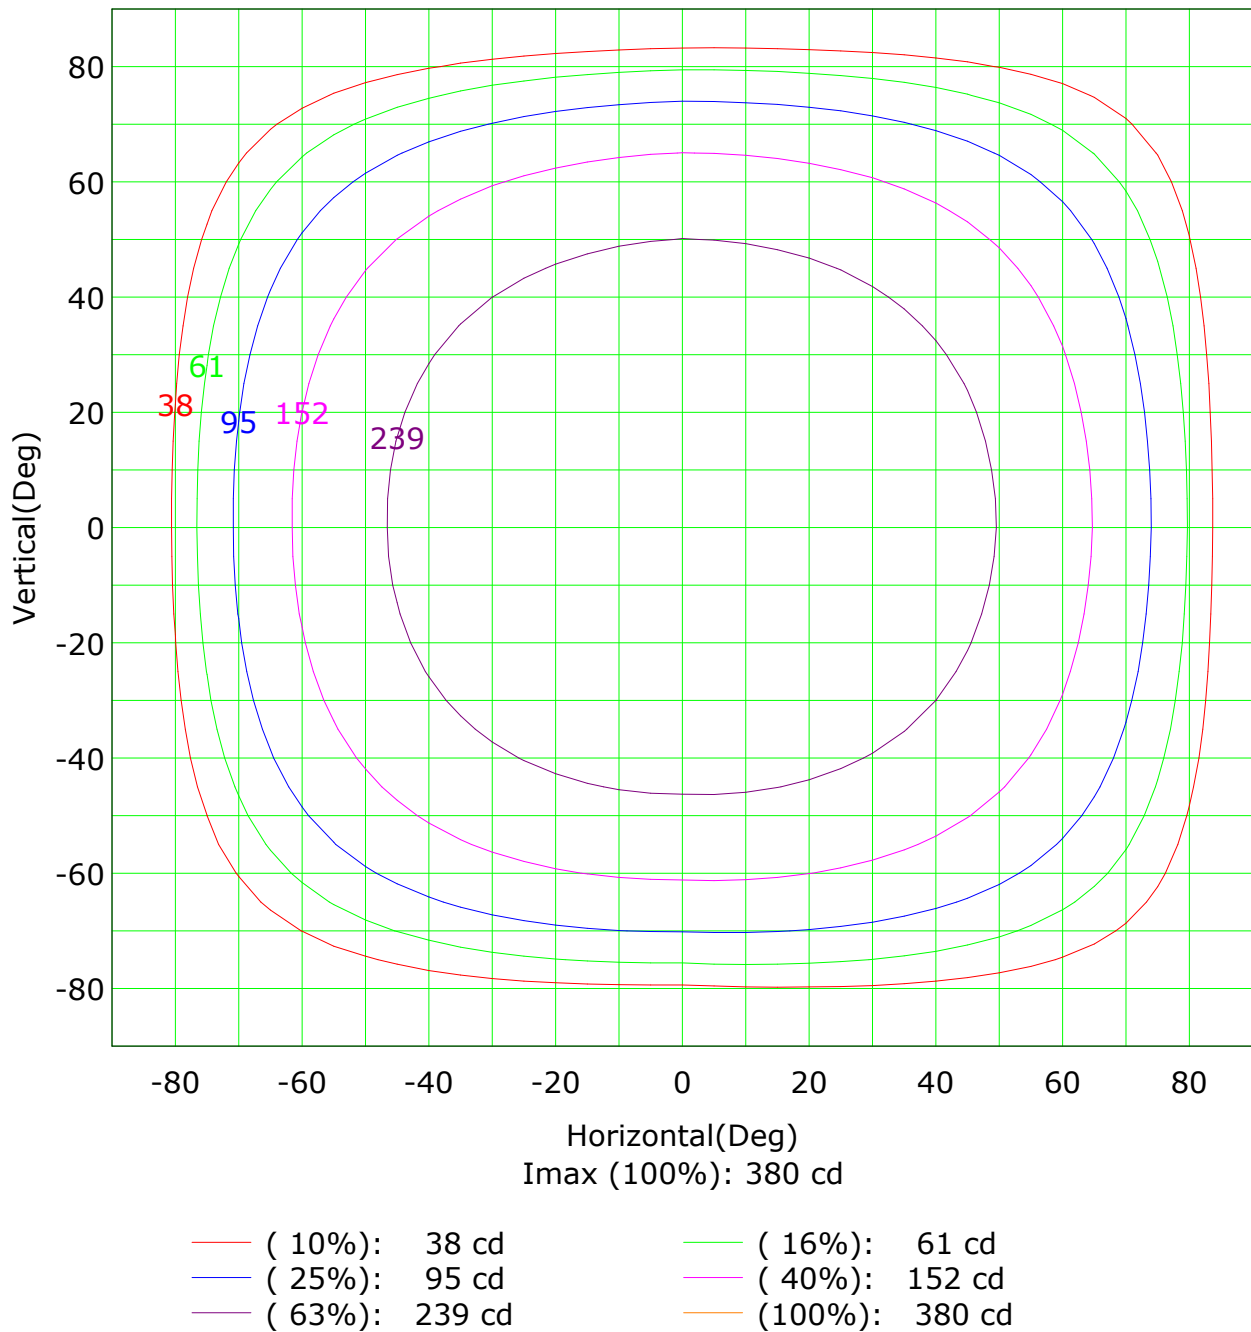

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Isocandela (sphere)

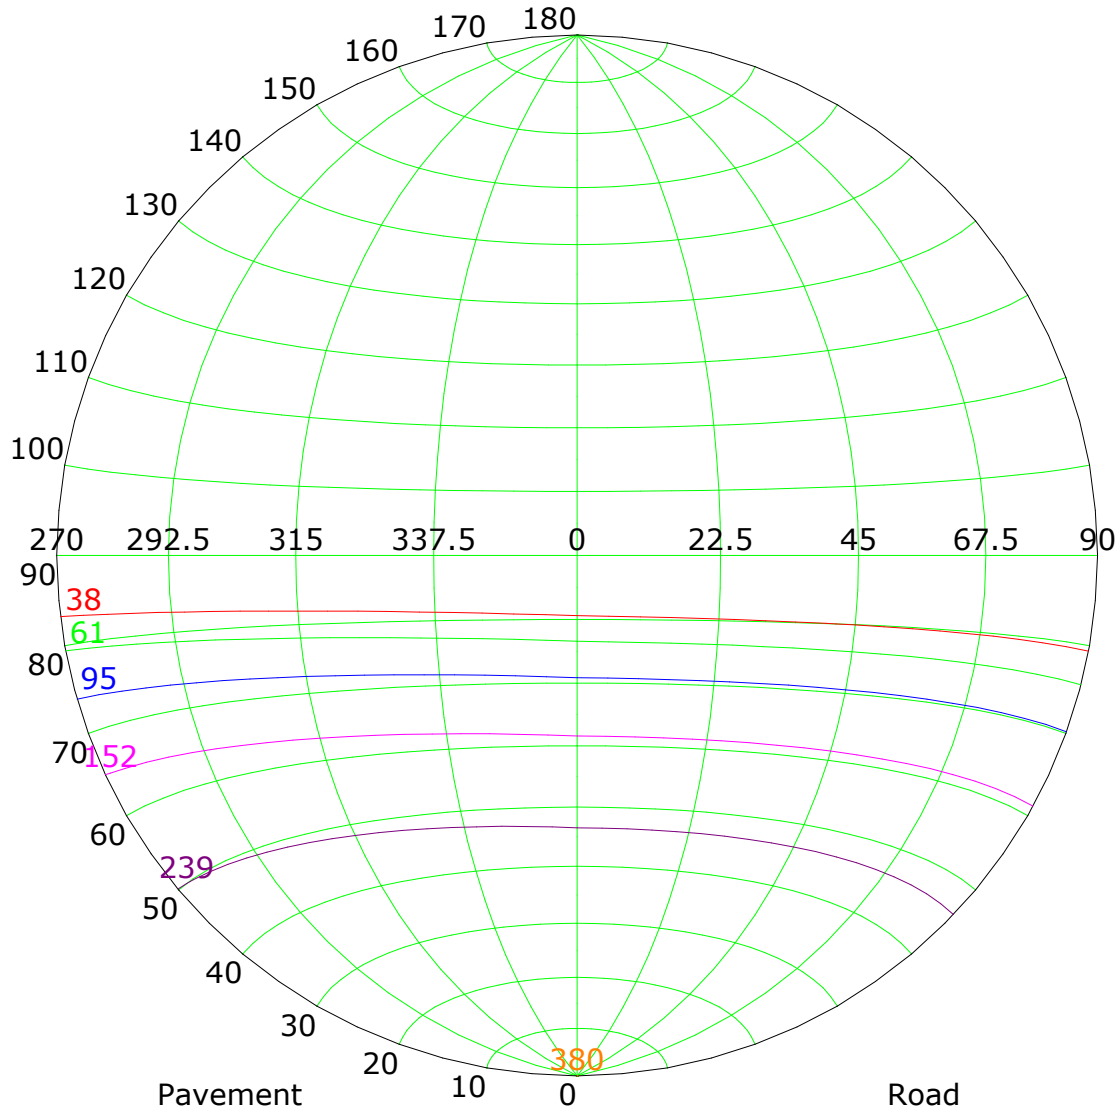

Imax (100%): 380 cd

( 10%): 38 cd  
( 25%): 95 cd  
( 63%): 239 cd

( 16%): 61 cd  
( 40%): 152 cd  
(100%): 380 cd


CIE: narrow - short  
CIE: Non-cut-off luminaire  
Max.At90: 81.654 cd/klm

IES: Non-cut-off  
Max.At80: 10870251339263246000.000 cd/klm  
Max.80-90: 580360608770679770000000000000.0

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:5.0  
Test Device: GPM-1600L  
Distance: 7.172 m [K=1.0000]  
Humidity:  
Inspector:

## IsoLux Plot

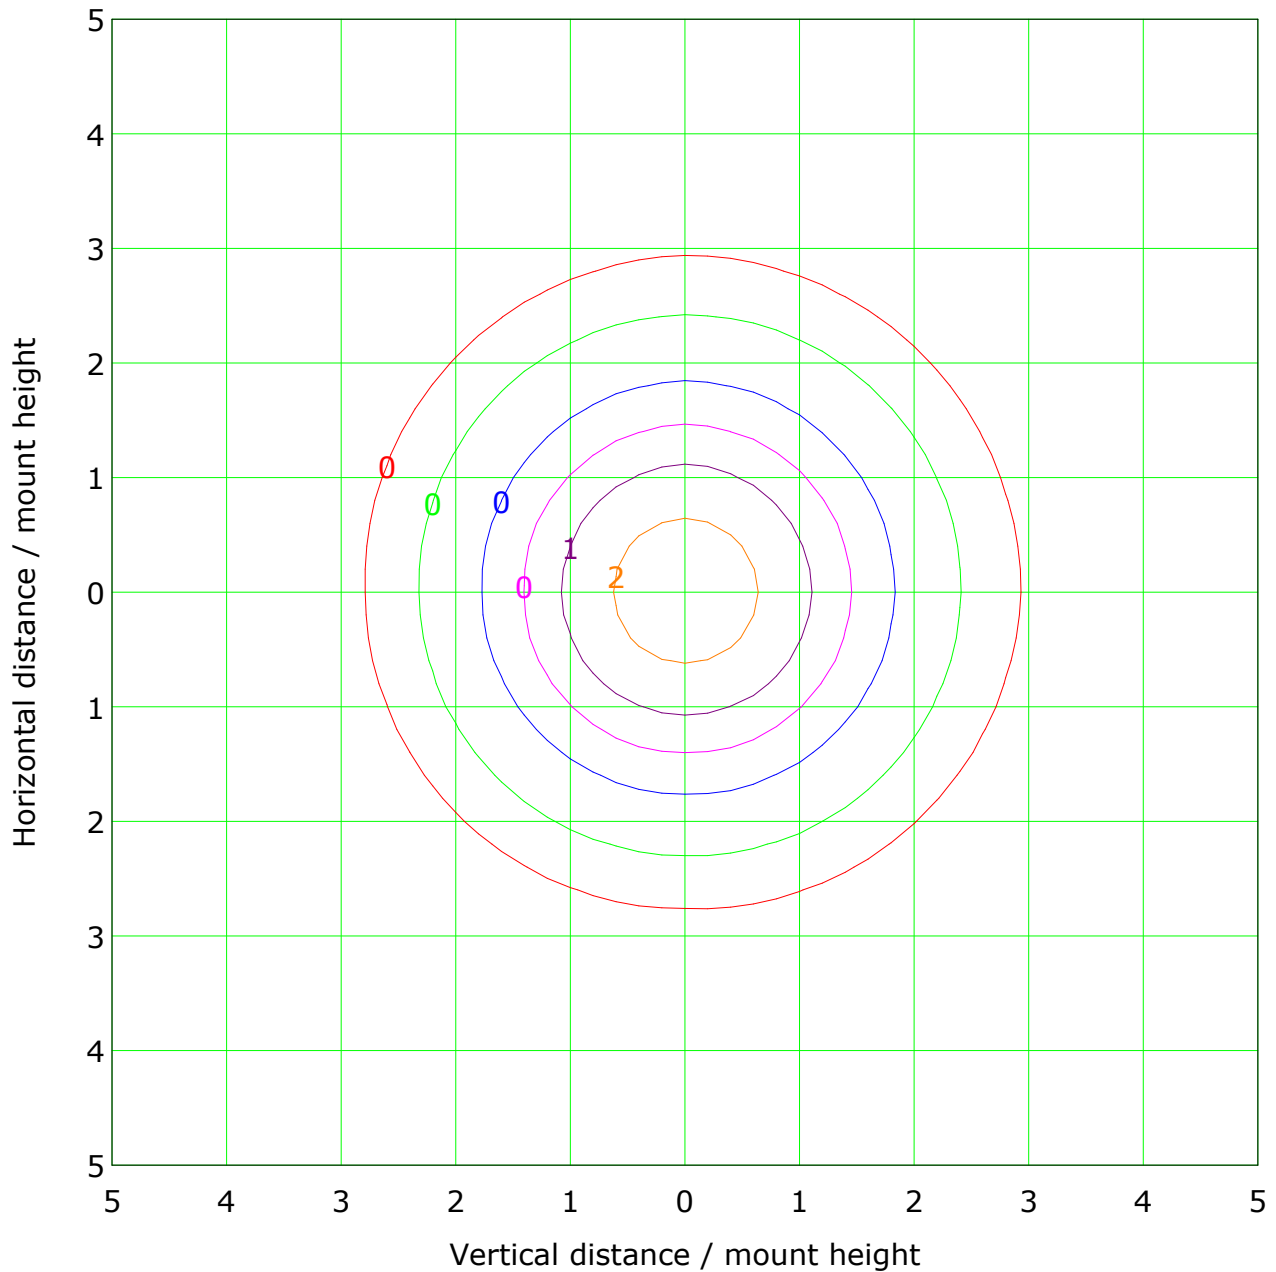

Mounting Height: 10.0m Max Lux(100%): 3.8 lx


- ( 1%): 0.0 lx
- ( 2%): 0.1 lx
- ( 5%): 0.2 lx
- ( 10%): 0.4 lx
- ( 20%): 0.8 lx
- ( 50%): 1.9 lx
- (100%): 3.8 lx

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Roadway CU Curve

Efficiency(%)

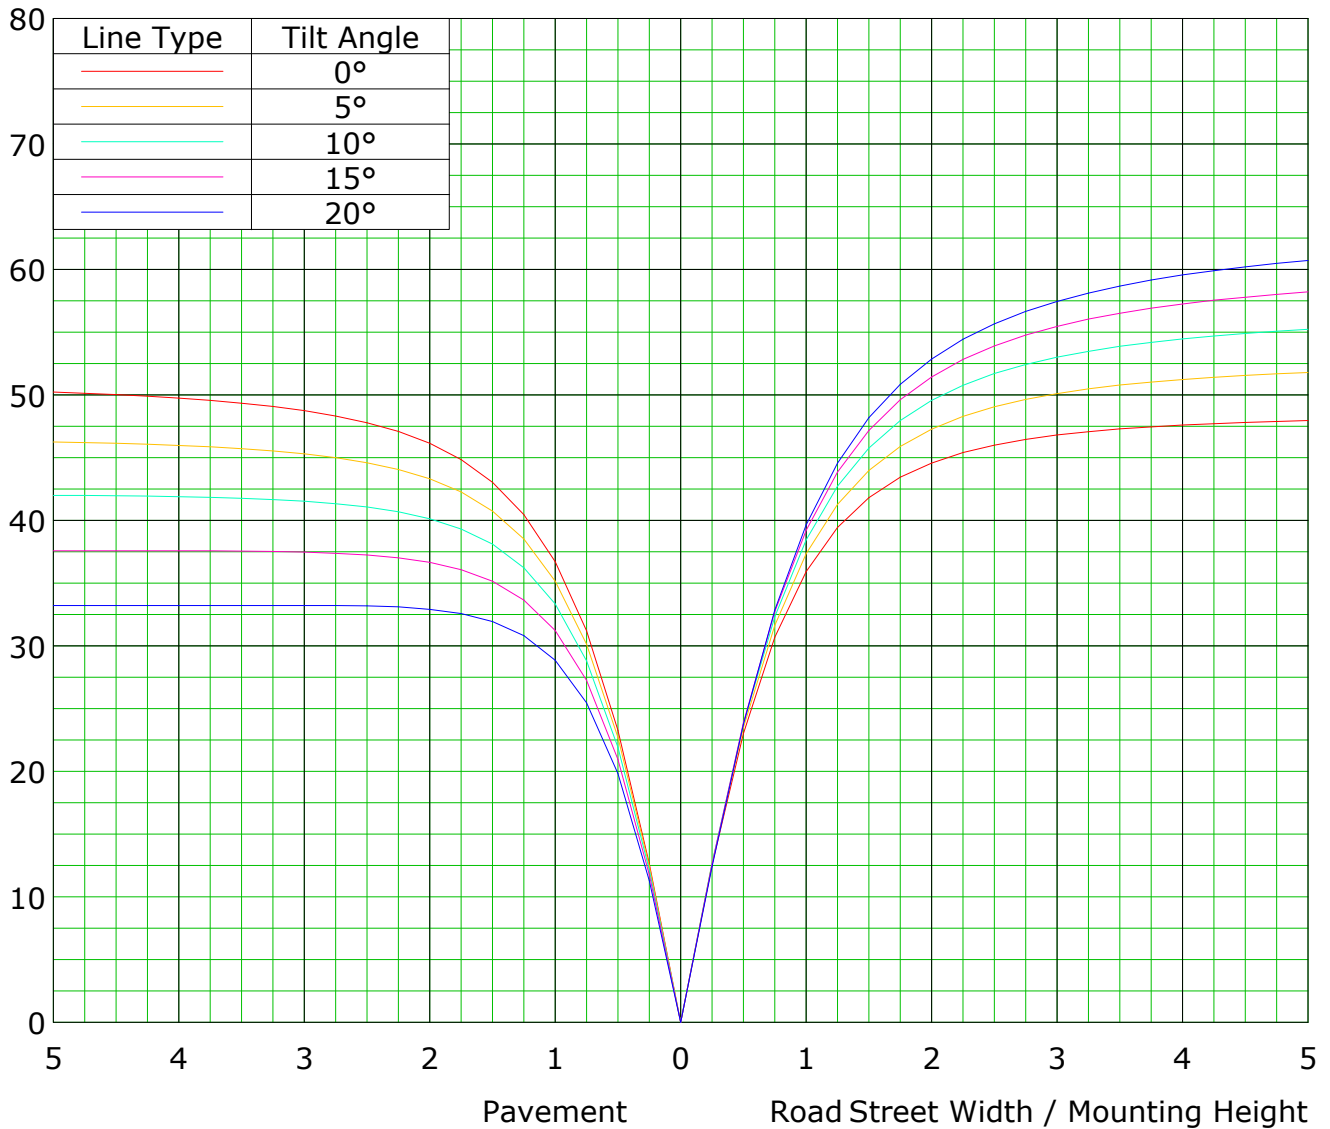



C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:



## Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

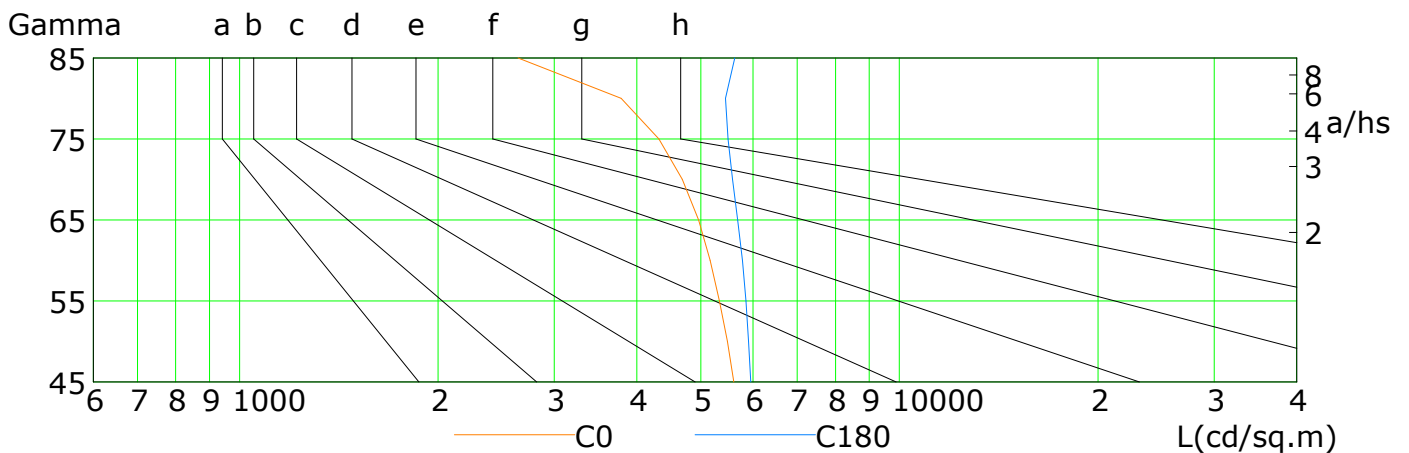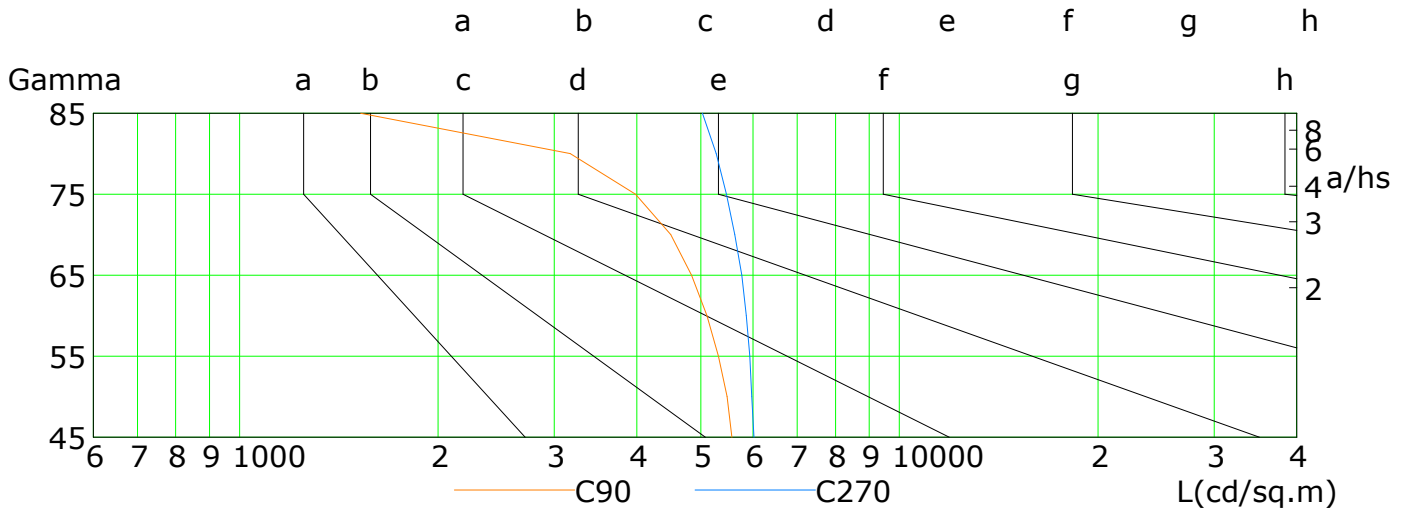

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	5608	5489	5338	5168	4964	4685	4319	3788	2644
C90	5575	5482	5321	5110	4843	4502	3982	3171	1526
C180	5951	5906	5853	5782	5686	5585	5499	5452	5632
C270	6018	5976	5935	5862	5767	5627	5468	5274	5028

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0


Test Device: GPM-1600L

Distance: 7.172 m [K=1.0000]

Humidity:

Inspector:


## Illuminance at a Distance

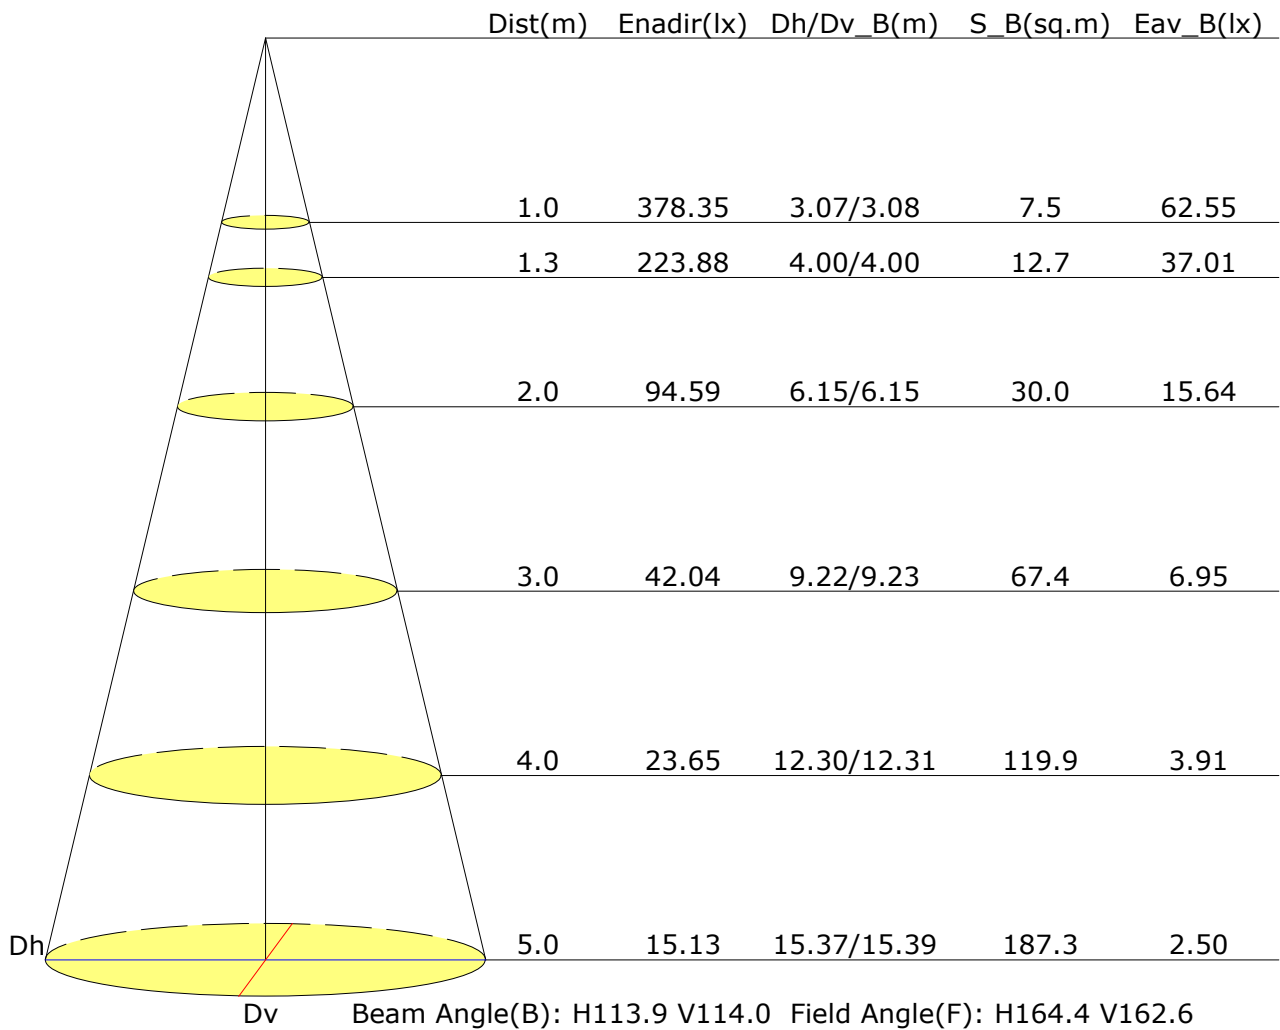

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Vertical IsoLux Plot

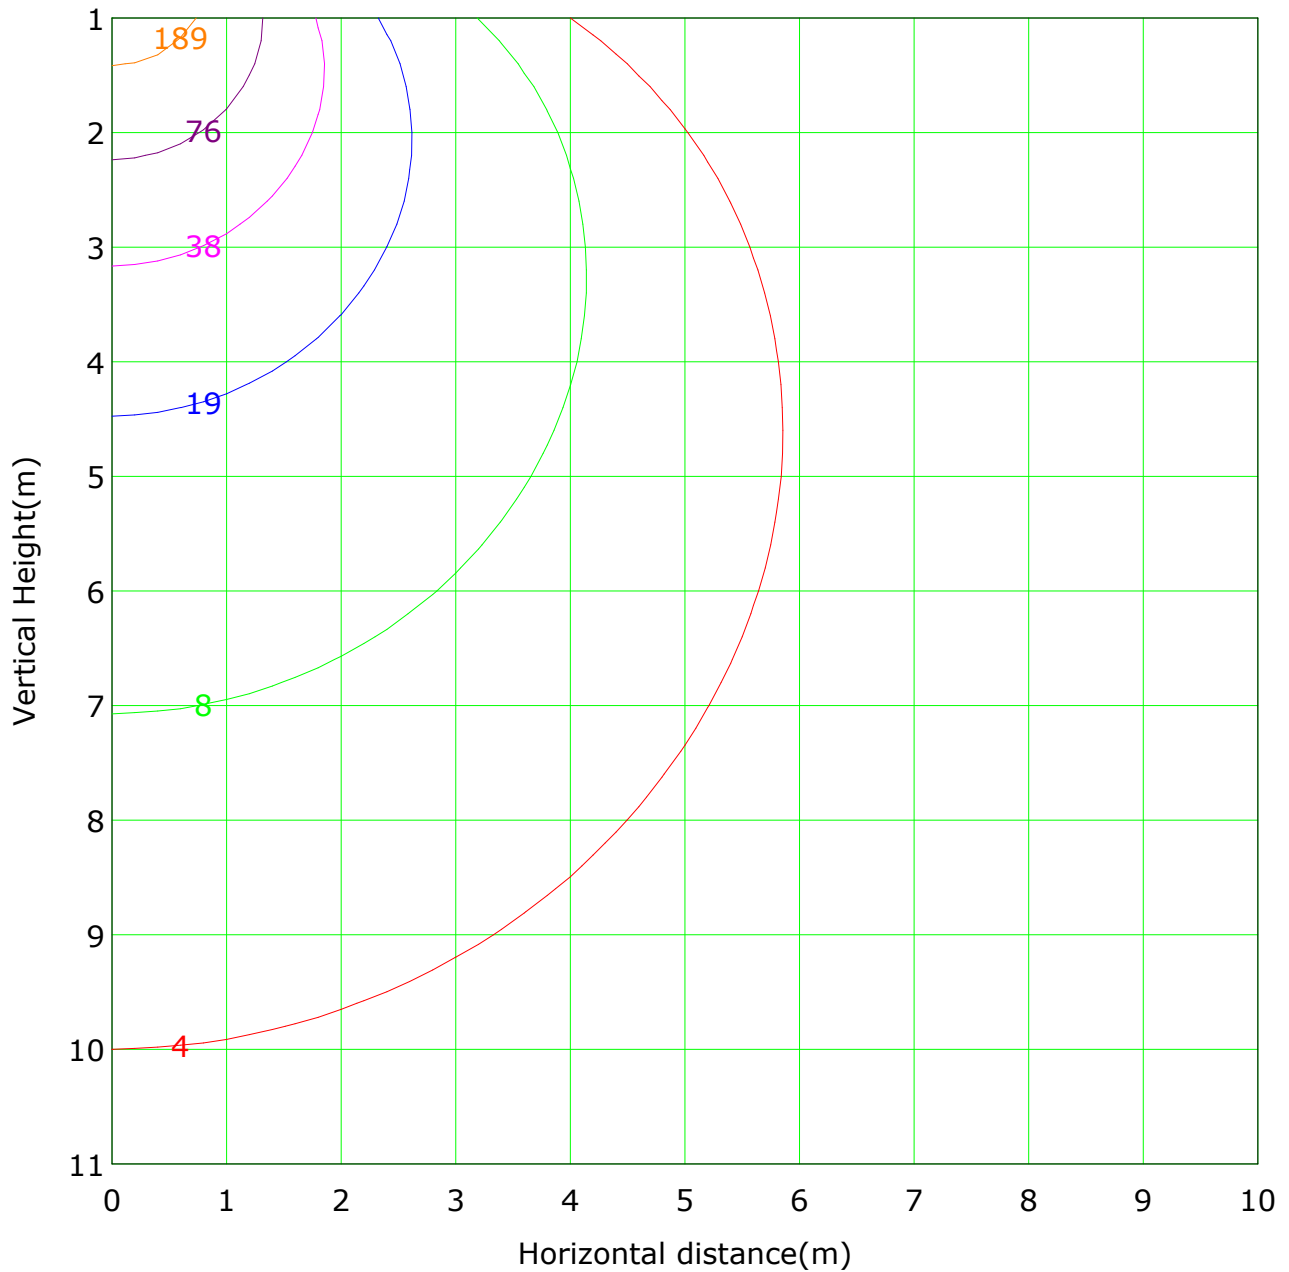

Lowest(m): 1.0m    Highest(m): 11.0m    Max Lux: 378.4 lx  
 ( 1%): 3.8 lx    ( 2%): 7.6 lx  
 ( 5%): 18.9 lx    ( 10%): 37.8 lx  
 ( 20%): 75.7 lx    ( 50%): 189.2 lx  
 (100%): 378.3 lx

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Area Flux Table


Unit: lm/klm

		Orbit: m/s/km																				
		-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90		
Vertical plane	-90	0.0	0.1	0.2	0.3	0.4	0.6	0.7	0.7	0.8	0.8	0.7	0.6	0.4	0.3	0.2	0.1	0.0	0.0	6.9	2.2	
	-80	0.0	0.2	0.4	0.8	1.2	1.6	2.0	2.3	2.4	2.4	2.2	1.9	1.4	1.0	0.6	0.3	0.1	0.0	20.8	19.6	
	-70	0.0	0.3	0.7	1.3	2.0	2.7	3.4	3.9	4.1	4.1	3.8	3.2	2.6	1.8	1.1	0.6	0.2	0.0	35.8	35.4	
	-60	0.1	0.4	1.0	1.8	2.8	3.8	4.7	5.4	5.8	5.7	5.3	4.6	3.6	2.6	1.6	0.8	0.3	0.0	50.3	50.1	
	-50	0.1	0.5	1.2	2.3	3.5	4.8	5.9	6.8	7.2	7.2	6.7	5.8	4.6	3.3	2.1	1.0	0.3	0.0	63.2	63.1	
	-40	0.1	0.5	1.4	2.7	4.1	5.6	6.9	7.9	8.4	8.4	7.8	6.8	5.4	3.9	2.4	1.2	0.4	0.0	74.0	73.9	
	-30	0.1	0.6	1.6	3.0	4.6	6.2	7.7	8.8	9.4	9.3	8.7	7.5	6.0	4.4	2.7	1.4	0.5	0.1	82.5	82.4	
	-20	0.1	0.6	1.7	3.2	4.9	6.7	8.2	9.4	10.0	10.0	9.3	8.0	6.4	4.7	2.9	1.5	0.5	0.1	88.2	88.1	
	-10	0.1	0.7	1.8	3.3	5.1	6.9	8.5	9.7	10.3	10.3	9.6	8.3	6.6	4.8	3.0	1.5	0.5	0.1	90.9	90.9	
	0	0.1	0.7	1.7	3.3	5.1	6.9	8.5	9.6	10.3	10.2	9.5	8.3	6.6	4.8	3.0	1.5	0.5	0.1	90.6	90.5	
	10	0.1	0.6	1.7	3.2	4.9	6.6	8.1	9.3	9.9	9.8	9.2	8.0	6.4	4.6	2.9	1.5	0.5	0.1	87.1	87.0	
	20	0.1	0.6	1.6	2.9	4.5	6.1	7.5	8.6	9.1	9.1	8.5	7.4	5.9	4.3	2.7	1.4	0.5	0.1	80.6	80.5	
	30	0.1	0.5	1.4	2.6	4.0	5.4	6.7	7.6	8.1	8.0	7.5	6.5	5.2	3.8	2.4	1.2	0.4	0.0	71.3	71.2	
	40	0.1	0.4	1.2	2.2	3.3	4.5	5.6	6.4	6.7	6.7	6.3	5.4	4.3	3.1	2.0	1.0	0.3	0.0	59.6	59.4	
	50	0.1	0.3	0.9	1.7	2.6	3.5	4.3	4.9	5.2	5.2	4.8	4.2	3.3	2.4	1.5	0.7	0.2	0.0	46.0	45.8	
	60	0.0	0.3	0.6	1.2	1.8	2.4	3.0	3.3	3.5	3.5	3.3	2.8	2.2	1.6	1.0	0.5	0.2	0.0	31.2	30.7	
	70	0.0	0.2	0.4	0.7	1.0	1.3	1.6	1.7	1.8	1.8	1.7	1.4	1.1	0.8	0.5	0.2	0.1	0.0	16.2	14.0	
	80	0.0	0.1	0.1	0.2	0.3	0.4	0.4	0.4	0.4	0.4	0.3	0.3	0.2	0.2	0.1	0.1	0.0	0.0	4.0	0.0	
	90	1.2	7.4	19.6	36.5	56.2	76.1	93.6	106.6	113.3	112.7	104.9	90.9	72.6	52.3	32.7	16.5	5.5	0.6	999		
	Flux(T)	0.5	6.6	18.8	35.7	55.4	75.2	92.8	105.8	112.5	111.9	104.1	90.1	71.7	51.5	31.9	15.6	4.5	0.0		985	
Flux(E)																						
		-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
		Horizontal plane																				

Gamma Plane (°):0.0-90.0:5.0  
Test Device: GPM-1600L  
Distance: 7.172 m [K=1.0000]  
Humidity:  
Inspector:

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

## The Average Illuminance Effective Figure

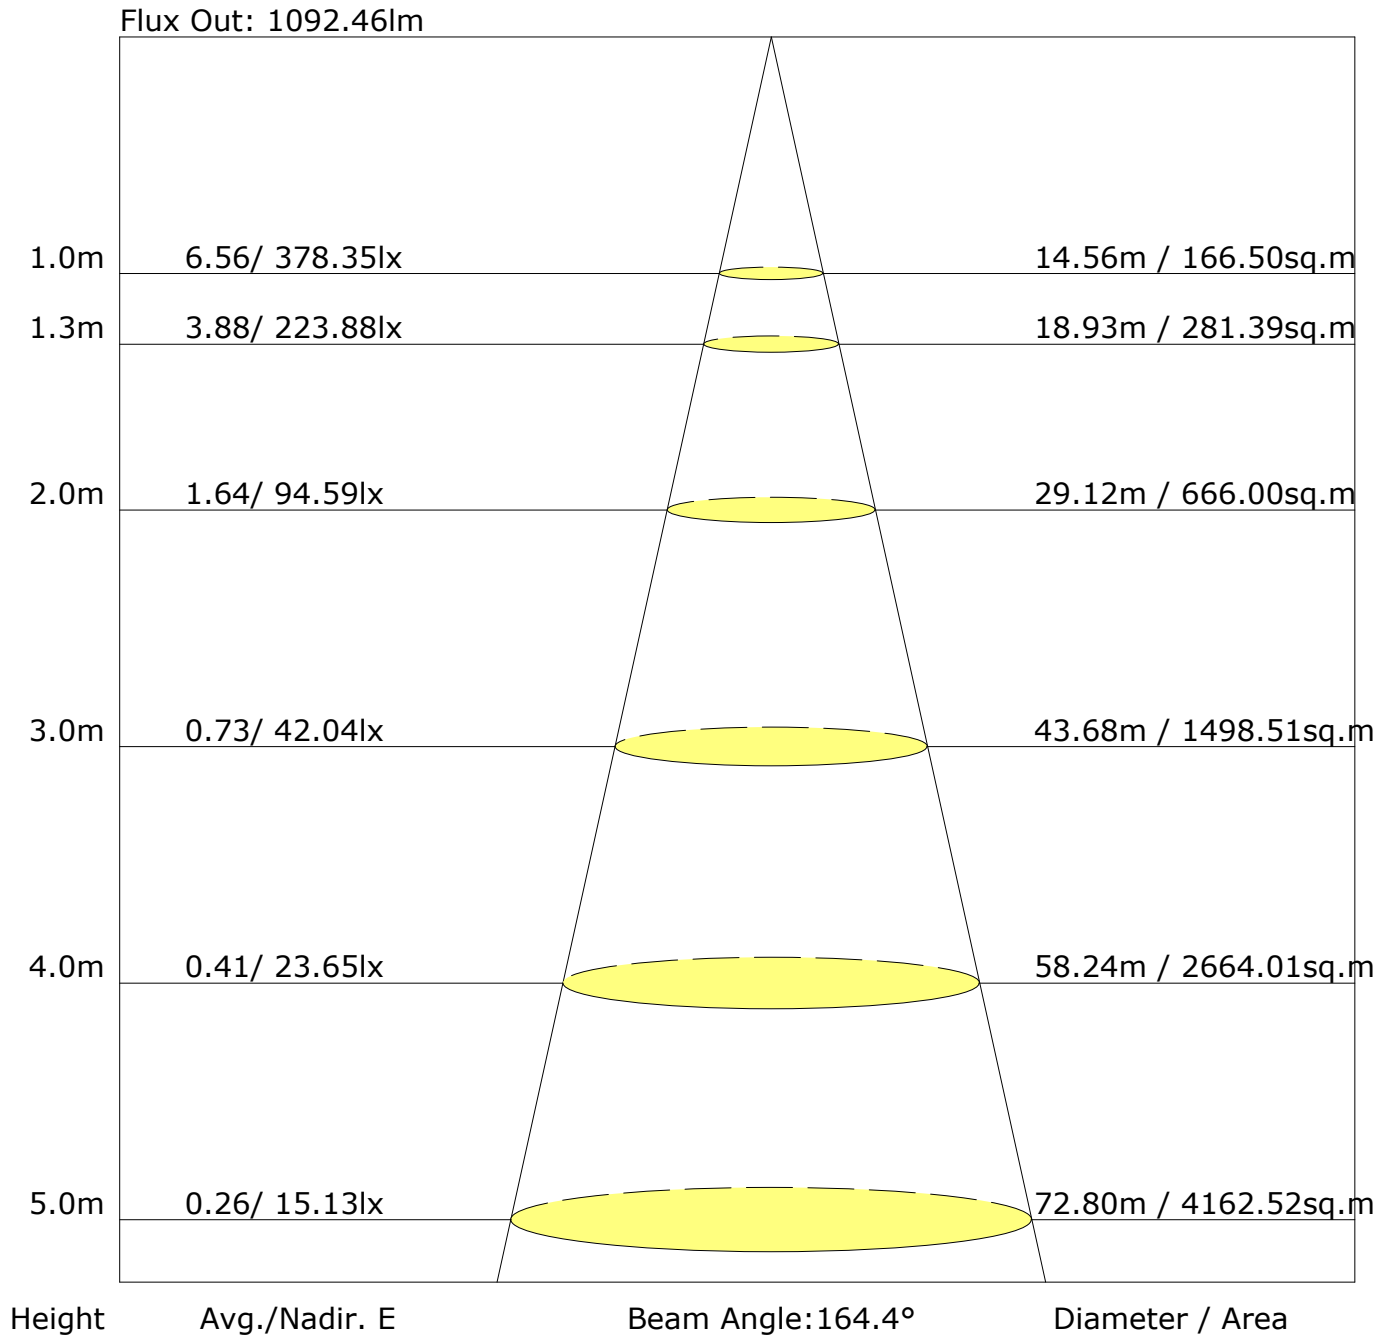

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	18.4	19.8	18.7	20.0	20.2	18.6	20.0	18.9	20.2	20.5
3H	19.9	21.2	20.2	21.4	21.7	20.2	21.5	20.5	21.7	22.0
4H	20.5	21.7	20.9	22.0	22.3	20.8	22.1	21.2	22.3	22.6
6H	20.9	22.1	21.3	22.4	22.7	21.3	22.5	21.7	22.8	23.1
8H	21.1	22.2	21.4	22.5	22.8	21.5	22.6	21.9	22.9	23.3
12H	21.1	22.2	21.5	22.5	22.9	21.6	22.7	22.0	23.0	23.3
X=4H Y=2H	19.1	20.3	19.4	20.6	20.9	19.2	20.4	19.6	20.7	21.0
3H	20.8	21.8	21.2	22.2	22.5	21.0	22.1	21.4	22.4	22.8
4H	21.5	22.5	21.9	22.8	23.2	21.8	22.8	22.2	23.1	23.5
6H	22.1	22.9	22.5	23.3	23.7	22.4	23.3	22.9	23.7	24.1
8H	22.3	23.0	22.7	23.4	23.9	22.7	23.4	23.1	23.8	24.3
12H	22.4	23.1	22.8	23.5	23.9	22.8	23.5	23.3	23.9	24.4
X=8H Y=4H	21.9	22.6	22.3	23.0	23.4	22.1	22.9	22.6	23.3	23.7
6H	22.6	23.2	23.0	23.6	24.1	22.9	23.5	23.4	23.9	24.4
8H	22.8	23.4	23.3	23.8	24.3	23.2	23.7	23.7	24.2	24.7
12H	23.0	23.4	23.5	23.9	24.4	23.4	23.9	23.9	24.4	24.9
X=12H Y=4H	21.9	22.6	22.3	23.0	23.4	22.1	22.8	22.6	23.2	23.7
6H	22.6	23.2	23.1	23.6	24.1	22.9	23.5	23.4	23.9	24.4
8H	22.9	23.4	23.4	23.9	24.4	23.3	23.8	23.8	24.2	24.7
Variations with the observer position at spacings:										
S=1.0H	+0.2/-0.2					+0.1/-0.1				
S=1.5H	+0.3/-0.5					+0.3/-0.3				
S=2.0H	+0.5/-0.8					+0.6/-0.8				

Calculate in accordance with CIE Pub.117. The table is revised with  $1107\text{lm}$  ( $8\log(F/F_0) = 0.4$ ).

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:5.0  
Test Device: GPM-1600L  
Distance: 7.172 m [K=1.0000]  
Humidity:  
Inspector:

## LCS Graph

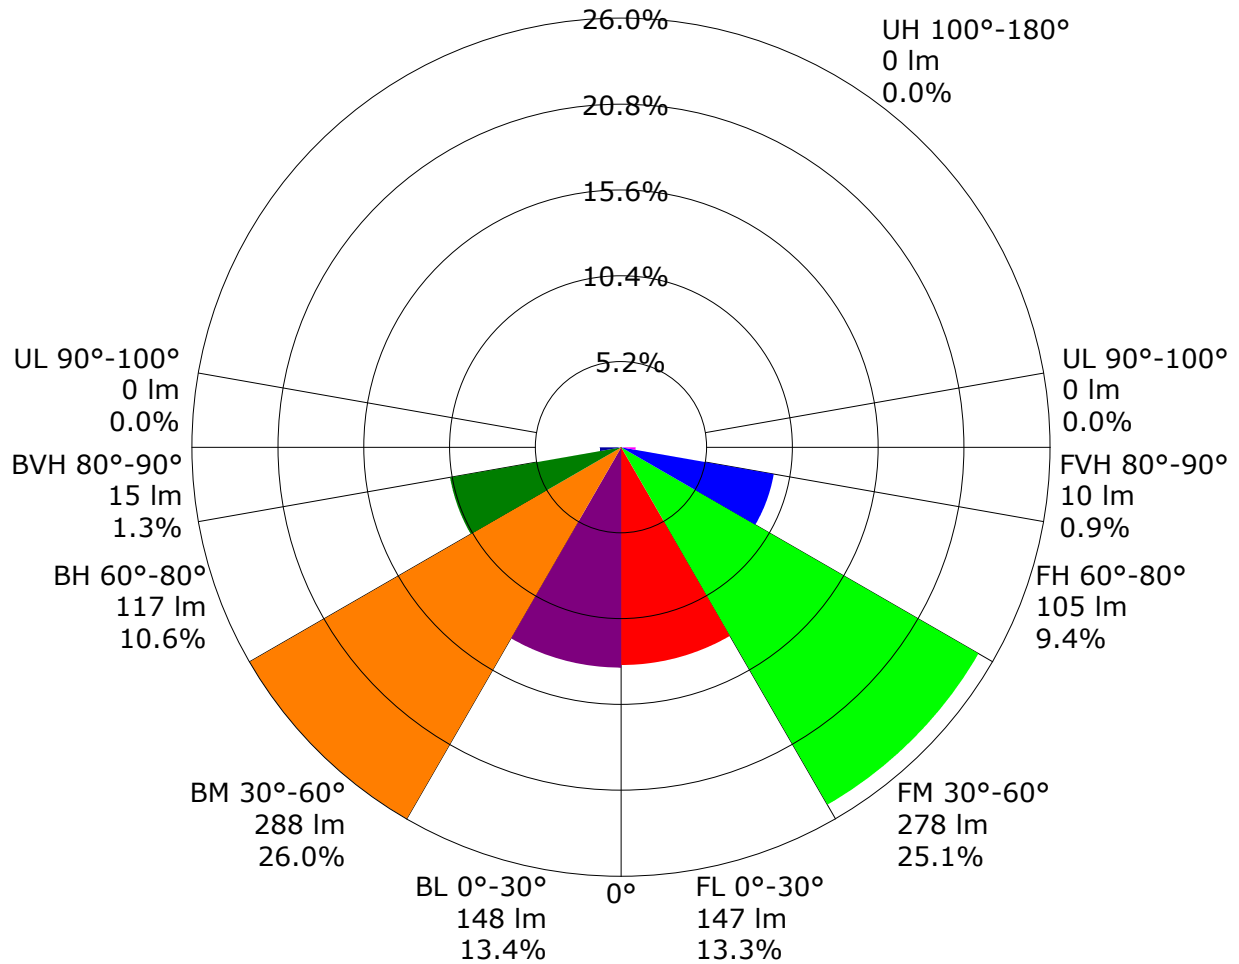

**Back Light**

**Forward Light**

Scale= MAX LCS%

Trapped Light:NA,NA

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.56	0.66	0.74	0.79	0.86	0.92	0.95	1.00	1.03	
	0.30		0.48	0.58	0.66	0.72	0.80	0.86	0.90	0.96	0.99	
	0.20		0.42	0.52	0.60	0.66	0.75	0.81	0.85	0.92	0.96	
0.50	0.50	0.20	0.54	0.64	0.71	0.76	0.83	0.88	0.91	0.96	0.99	
	0.30		0.47	0.57	0.65	0.70	0.78	0.83	0.87	0.92	0.96	
	0.20		0.42	0.52	0.59	0.65	0.73	0.79	0.83	0.89	0.93	
0.30	0.50	0.20	0.53	0.62	0.69	0.74	0.80	0.85	0.88	0.92	0.95	
	0.30		0.46	0.56	0.63	0.68	0.76	0.81	0.84	0.89	0.92	
	0.20		0.41	0.51	0.59	0.64	0.72	0.77	0.81	0.87	0.90	
0.00	0.00	0.00	0.39	0.49	0.56	0.61	0.68	0.74	0.77	0.82	0.85	
Rating:10W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:



## Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	1.01	0.84	0.71	0.62	0.50	0.41	0.35	0.28	0.22	
	0.30		0.84	0.72	0.62	0.55	0.45	0.38	0.33	0.26	0.21	
	0.20		0.72	0.63	0.55	0.49	0.41	0.35	0.31	0.24	0.20	
0.50	0.50	0.20	0.98	0.81	0.69	0.60	0.48	0.43	0.34	0.26	0.21	
	0.30		0.83	0.70	0.61	0.54	0.44	0.37	0.32	0.25	0.21	
	0.20		0.72	0.62	0.54	0.48	0.40	0.34	0.30	0.24	0.20	
0.30	0.50	0.20	0.95	0.77	0.66	0.57	0.46	0.38	0.32	0.25	0.21	
	0.30		0.81	0.68	0.59	0.52	0.42	0.35	0.30	0.24	0.20	
	0.20		0.71	0.61	0.53	0.48	0.39	0.33	0.29	0.23	0.19	
0.00	0.00	0.00	0.61	0.51	0.44	0.39	0.32	0.27	0.23	0.18	0.15	
Rating:10W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.16	0.18	0.19	0.19	0.20	0.21	0.21	0.22	0.22	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.05	0.06	0.08	0.09	0.11	0.13	0.14	0.16	0.17	
0.50	0.50	0.20	0.16	0.17	0.18	0.18	0.19	0.20	0.20	0.21	0.21	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.04	0.06	0.08	0.09	0.11	0.12	0.13	0.15	0.16	
0.30	0.50	0.20	0.15	0.16	0.17	0.18	0.19	0.19	0.19	0.20	0.20	
	0.30		0.09	0.11	0.12	0.13	0.14	0.15	0.16	0.17	0.18	
	0.20		0.04	0.06	0.07	0.09	0.10	0.12	0.13	0.15	0.16	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:10W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-90.0:5.0  
 Test Device: GPM-1600L  
 Distance: 7.172 m [K=1.0000]  
 Humidity:  
 Inspector:

## Zonal Lumen

[illegible]

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:5.0  
Test Device: GPM-1600L  
Distance: 7.172 m [K=1.0000]  
Humidity:  
Inspector:

## Zonal Lumen (Continue 1)

cone flux(90°): 583.45 lm

%lum = 52.7%  
%lamp = 52.7%

cone flux(120°): 861.25 lm

%lum = 77.8%  
%lamp = 77.8%

## Unit: cd/klm

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:5.0  
Test Device: GPM-1600L  
Distance: 7.172 m [K=1.0000]  
Humidity:  
Inspector:

## LED Average Luminance Report

Avg.L	cd/m <sup>2</sup>
L 0-180(65) av	5324.90
L 0-180(75) av	4909.38
L 0-180(85) av	4137.88
L 90-270(65) av	5304.84
L 90-270(75) av	4724.85
L 90-270(85) av	3276.89
L 45(65) av	5314.87
L 45(75) av	4817.11
L 45(85) av	3707.39

Standard: GB/T 29293-2012